

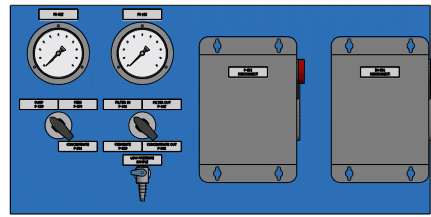


CONNECTION SCHEDULE						
TP	DESCRIPTION	LOCATION	MAX. FLOW	SIZE	CONNECTION	MATERIAL
1	RAW WATER INLET	R.O. SKID	100 GPM	3"	150# FLANGE	SCH. 80 PVC
2	PERMEATE TO STORAGE	R.O. SKID	60 GPM	2"	150# FLANGE	SCH. 80 PVC
3	CONCENTRATE TO WASTE	R.O. SKID	40 GPM	2"	150# FLANGE	SCH. 80 PVC
4	OFF SPEC PERMEATE	R.O. SKID	60 GPM	2"	150# FLANGE	SCH. 80 PVC
5	INSTRUMENT AIR	R.O. SKID	AR	1/2"	FNPT	GALV
F1	CIP FEED	R.O. SKID	60 GPM	2"	CAMLOCK	
F2	CIP FEED	R.O. SKID	60 GPM	2"	GROOVED COUPLING	
C1	CIP CONCENTRATE	R.O. SKID	60 GPM	2"	CAMLOCK	
C2	CIP CONCENTRATE	CIP/FLUSH TANK	60 GPM	2"	CAMLOCK	
R1	CIP RECIRCULATION	R.O. SKID	60 GPM	2"	CAMLOCK	
R2	CIP RECIRCULATION	CIP/FLUSH TANK	60 GPM	2"	CAMLOCK	


DESCRIPTION	wt (lbs)	HEIGHT (in)	WIDTH (in)	DEPTH (in)
R.O. SKID	5200	78	280	52
CIP TANK	400	72	73	-
MCP	50	24	20	8
MCC	60	36	30	10
VFD	86	25	13	10

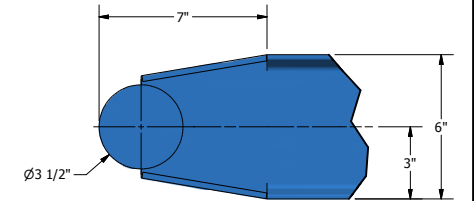

PANEL VIEW

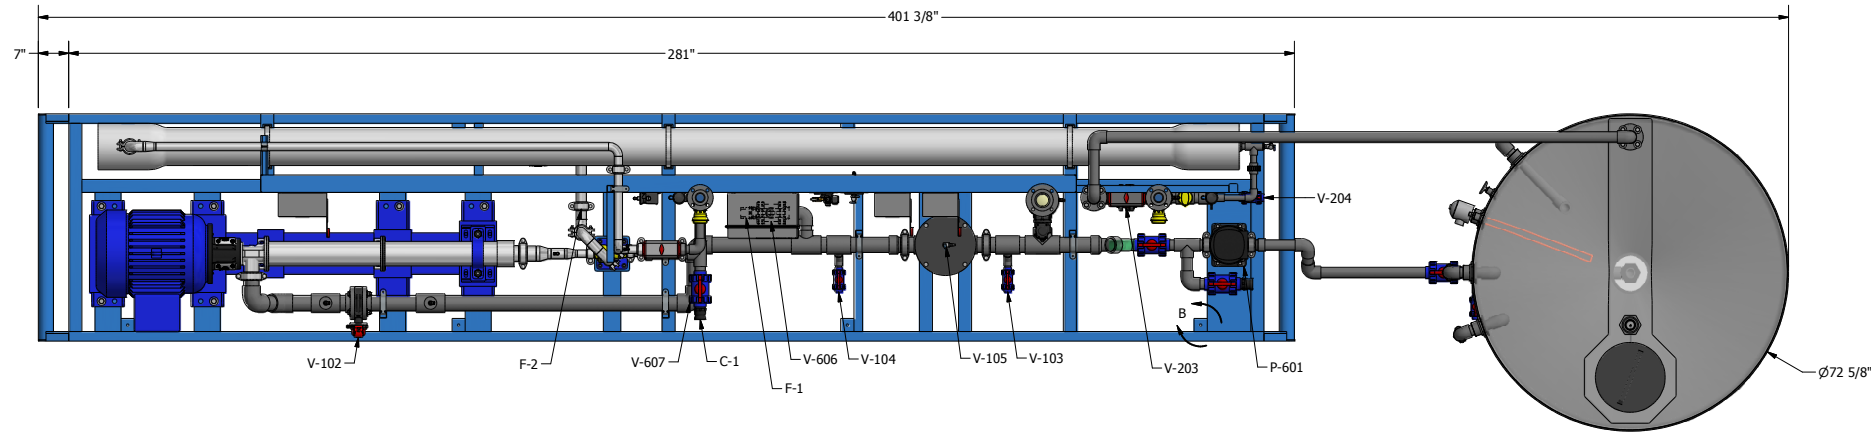

DETAIL A  
(4 PLACES)

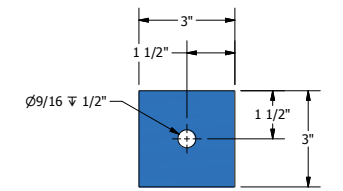

DETAIL B  
(8 PLACES)

